




**CROSS SECTION - BUILDING C-1
ROOF DRAIN RECHARGE STRUCTURES**
SCALE 1" = 4'

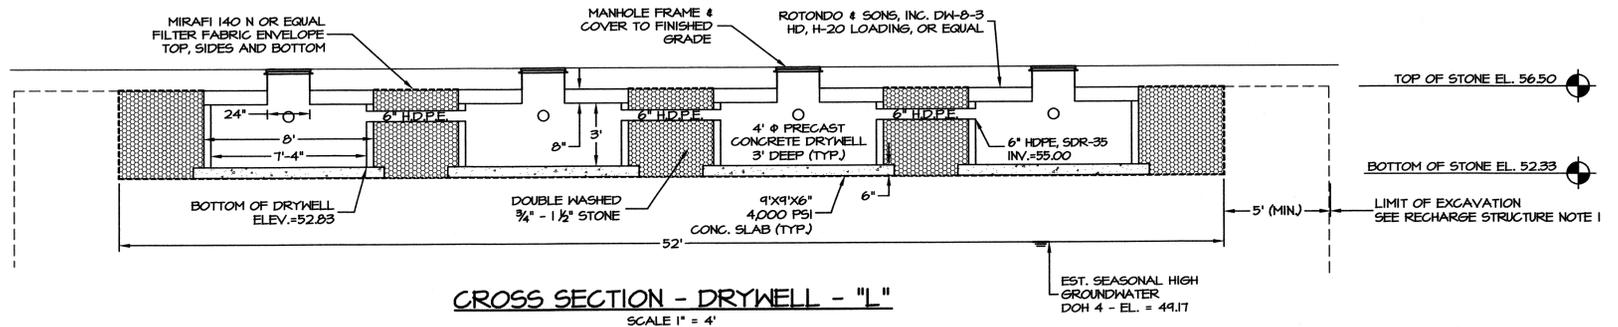

CROSS SECTION - DRYWELL - "L"
SCALE 1" = 4'

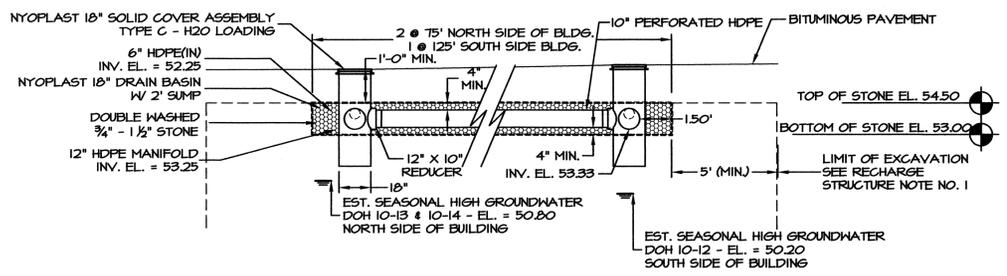


**PROFILE - BUILDING C-1
ROOF DRAIN RECHARGE STRUCTURES**
SCALE 1" = 4'

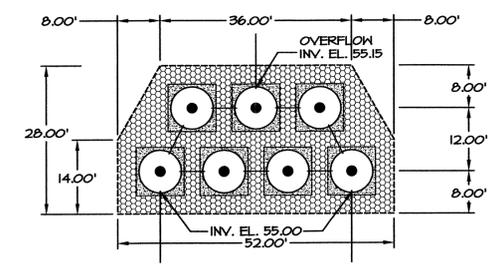


PLAN VIEW DRYWELL - "L"
SCALE 1" = 16'

STORMWATER RECHARGE STRUCTURE NOTES:


1. STRIP ALL TOPSOIL, SUBSOIL AND UNSUITABLE MATERIAL, FILL, TREE ROOTS AND STUMPS AND ANY OTHER IMPERVIOUS OR SPECIFIED SOIL IN THE AREA OF THE STRUCTURE AND 5 FEET BEYOND HORIZONTALLY IN ALL DIRECTIONS, WHERE POSSIBLE. STRIP MATERIAL VERTICALLY TO 3" MINIMUM INTO PERMEABLE NATIVE SOIL. REPLACE WITH GRANULAR FILL MEETING THE LATEST SPECIFICATIONS OF 300 CHR 15.00: THE STATE ENVIRONMENTAL CODE, TITLE 5 (2006), SECTION 15.235 (3).
2. IF CONDITIONS ENCOUNTERED DURING CONSTRUCTION VARY SUBSTANTIALLY FROM THOSE SHOWN ON THIS PLAN, NOTIFY CAPUTO AND WICK, LTD. BEFORE PROCEEDING WITH CONSTRUCTION.
3. ALL STONE USED FOR CONSTRUCTION OF THE SYSTEM MUST BE DOUBLE WASHED 3/4" - 1 1/2" AS SPECIFIED BY TITLE 5, SECTION 15.241. ACTUAL STONE MATERIAL MAY ALSO BE SUBJECT TO APPROVAL BY ENGINEER.
4. MATERIAL AND EQUIPMENT FROM ALTERNATE MANUFACTURERS MAY BE USED IF EQUAL. APPROVAL FOR ALTERNATE MATERIAL AND/OR EQUIPMENT REQUIRED FROM ENGINEER PRIOR TO CONSTRUCTION. FULL SPECIFICATIONS FOR ALTERNATE EQUIPMENT MUST BE PROVIDED BY CONTRACTOR.
5. THE DESIGNER EXPRESSLY DISCLAIMS ANY RESPONSIBILITY FOR MONITORING, INSPECTING OR SUPERVISING THE ACTUAL CONSTRUCTION WORK. THE DESIGNER EXPRESSLY DISCLAIMS ANY RESPONSIBILITY, FOR THE INSTALLATION AND MAINTENANCE OF THE SYSTEM.
6. THE DESIGNER EXPRESSLY DISCLAIMS ANY RESPONSIBILITY FOR MONITORING, INSPECTING OR SUPERVISING THE ACTUAL CONSTRUCTION WORK. THE DESIGNER EXPRESSLY DISCLAIMS ANY RESPONSIBILITY, FOR THE INSTALLATION AND MAINTENANCE OF THE SYSTEM.
7. FILL MEETING THE REQUIREMENTS OF TITLE 5, SECTION 15.255 MUST BE PLACED ON SCARIFIED, RELATIVELY DRY NATIVE SOIL. THE CONTRACTOR SHALL PROVIDE FOR DEWATERING AS REQUIRED AND ALL WORK SHALL BE PERFORMED UNDER DRY CONDITIONS. IF DEWATERING IS NECESSARY DISCHARGE WATER MUST BE FILTERED THROUGH A "DANDY DEWATERING BAG", OR EQUAL.
8. BACKFILL RECHARGE STRUCTURE WITH WELL GRADED GRANULAR BACKFILL WHICH CONTAIN AN EVEN DISTRIBUTION OF PARTICLE SIZES WITH NO MORE THAN 12% PASSING THE #200 SIEVE COMPACTED TO A MINIMUM OF 95% OF THE STANDARD PROCTOR DENSITY.

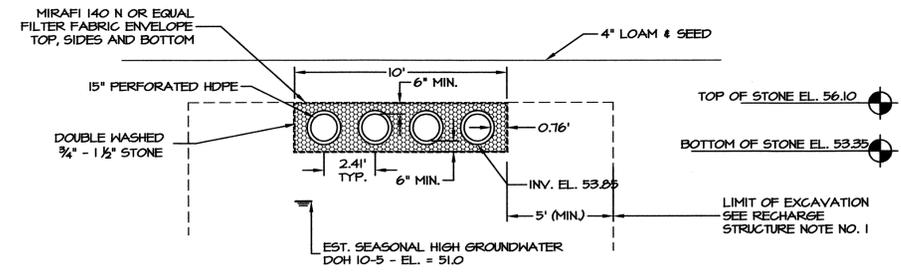


**CROSS SECTION - BUILDINGS C-2 AND E
ROOF DRAIN RECHARGE STRUCTURE**
SCALE 1" = 4'

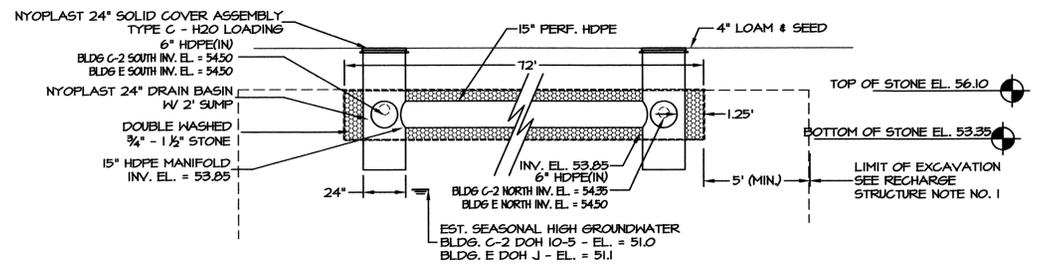


**PROFILE - BUILDINGS C-2 AND E
ROOF DRAIN RECHARGE STRUCTURE**
SCALE 1" = 4'

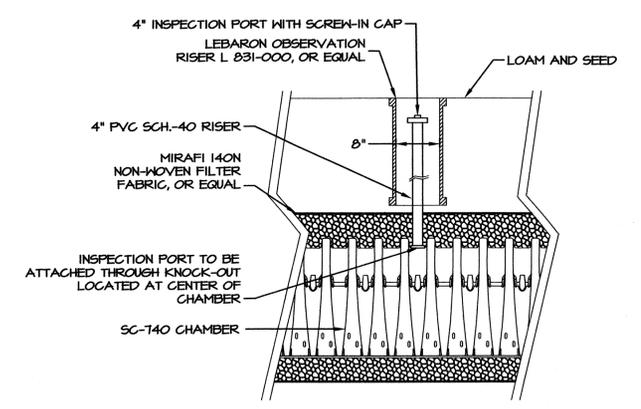


STORMTECH INSPECTION PORT
NOT TO SCALE

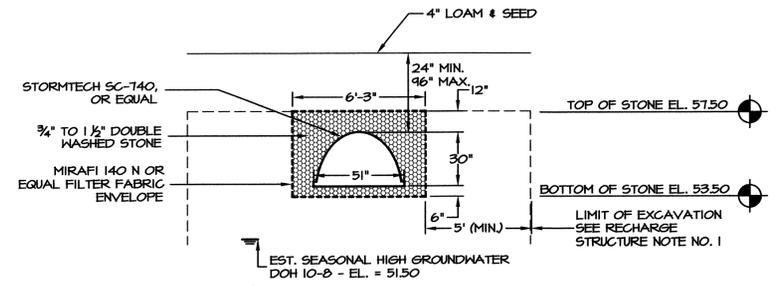

**CROSS SECTION - TOWNHOUSE
ROOF DRAIN RECHARGE STRUCTURE**
SCALE 1" = 4'

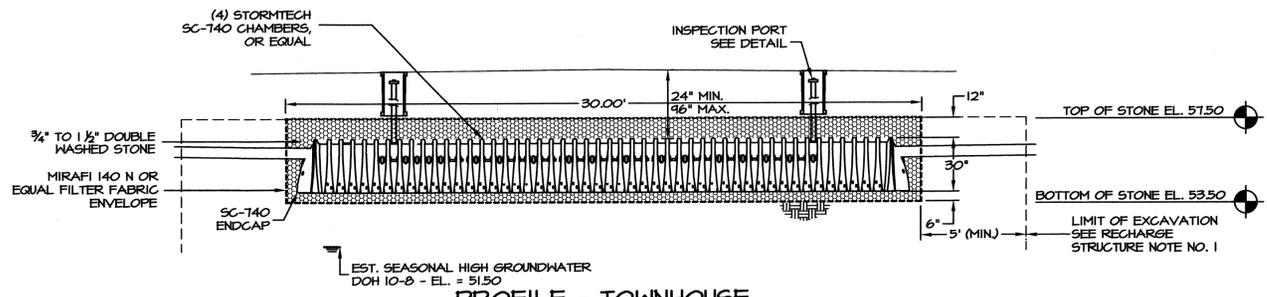

**PROFILE - TOWNHOUSE
ROOF DRAIN RECHARGE STRUCTURE**
SCALE 1" = 4'



DETAIL SHEET NO. 5
GREENBRIER CONDOMINIUMS
PREPARED FOR
RI SEEKONK HOLDINGS, LLC
FALL RIVER AVENUE & COLE STREET
SEEKONK, MASSACHUSETTS

CAPUTO AND WICK LTD.
1150 PAWTUCKET AVE.
RUMFORD, R.I. 02916
401-434-8880

DATE: MARCH 10, 2010
REV. APR. 2010
SHEET: 20A OF 21