
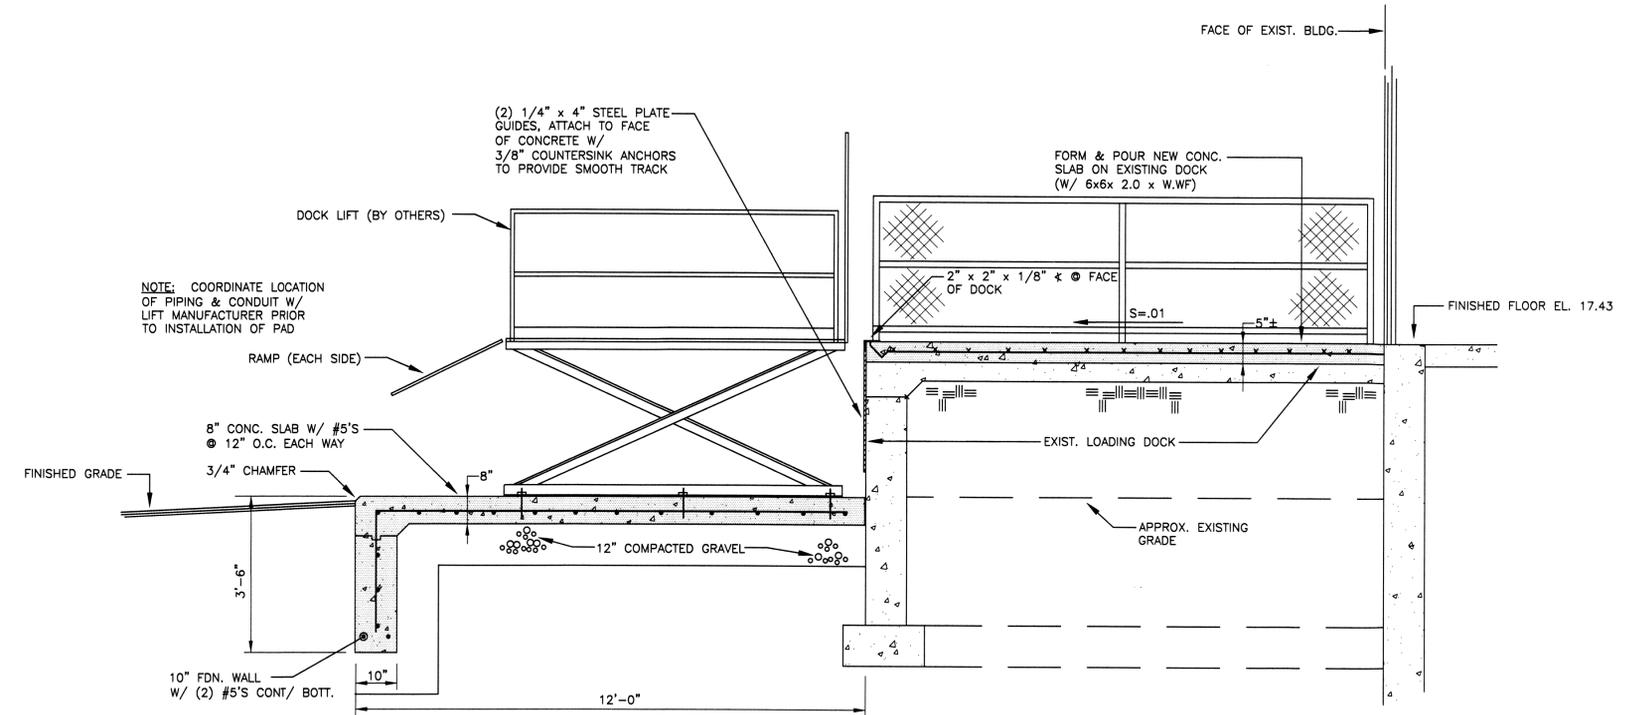


- GENERAL NOTES:**
- ALL WORK SHALL CONFORM TO THE MASSACHUSETTS STATE BUILDING CODE, ITS APPLICABLE REFERENCED STANDARDS, AND LOCAL CODES.
 - IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS AS THEY RELATE TO NEW CONSTRUCTION. REPORT TO THE ARCHITECT/ENGINEER ALL OBSERVATIONS AND ANY DISCREPANCIES BEFORE PROCEEDING WITH ANY WORK.
 - IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO PROVIDE FOR A SAFE AND EFFICIENT METHOD OF SHORING AND/OR BRACING THE EXISTING STRUCTURE DURING BOTH DEMOLITION AND NEW CONSTRUCTION PHASES. SUBMIT AN OUTLINE OF PROPOSED PROCEDURE TO THE ARCHITECT/ENGINEER BEFORE DEMOLITION OPERATIONS BEGIN.
 - SUBMIT COMPLETE SHOP DRAWINGS AND SCHEDULES OF ALL STRUCTURAL ELEMENTS TO THE ENGINEER FOR APPROVAL PRIOR TO FABRICATION.
 - THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR CONTACTING DIG-SAFE PRIOR TO STARTING ANY WORK.
- CONCRETE NOTES:**
- ALL CONCRETE WORK SHALL CONFORM TO ACI 318 & 301 REQUIREMENTS.
 - CONCRETE SHALL HAVE THE FOLLOWING 28-DAY COMPRESSIVE STRENGTH:
EXTERIOR SLABS ON GRADE - 4000 PSI
ALL OTHER CONCRETE - 3000 PSI
 - CONCRETE REINFORCING SHALL BE IN ACCORDANCE WITH ASTM A615, GRADE 60. INSTALLATION SHALL BE IN ACCORDANCE WITH ACI 315 AND 318.
 - WELDED WIRE FABRIC SHALL BE IN ACCORDANCE WITH ASTM A185.
 - PROVIDE THE FOLLOWING MINIMUM REINFORCING COVER:
A. FOOTINGS - 3 INCHES
B. CONC. EXPOSED TO WEATHER OR EARTH - 2 INCHES
C. SLABS ON GRADE (STEEL BARS) - 2 INCHES
 - FOUNDATIONS HAVE BEEN ASSUMED TO BEAR UPON VIRGIN SOIL OR COMPACTED ENGINEERED FILL HAVING A MINIMUM BEARING CAPACITY OF 1.5 TONS/S.F. SOIL TESTING SHOULD BE PERFORMED.
 - ENGINEERED FILL UNDER BUILDING SHALL BE PLACED IN 8" LAYERS AND COMPACTED TO 95% MAX. DRY DENSITY.
 - PROVIDE CORNER BARS AT ALL WALL CORNERS & INTERSECTIONS MATCHING HORIZONTAL REINFORCEMENT WITH 2'-6" MINIMUM LAPS.
 - LAP ALL BARS 40 DIAMETERS MINIMUM.

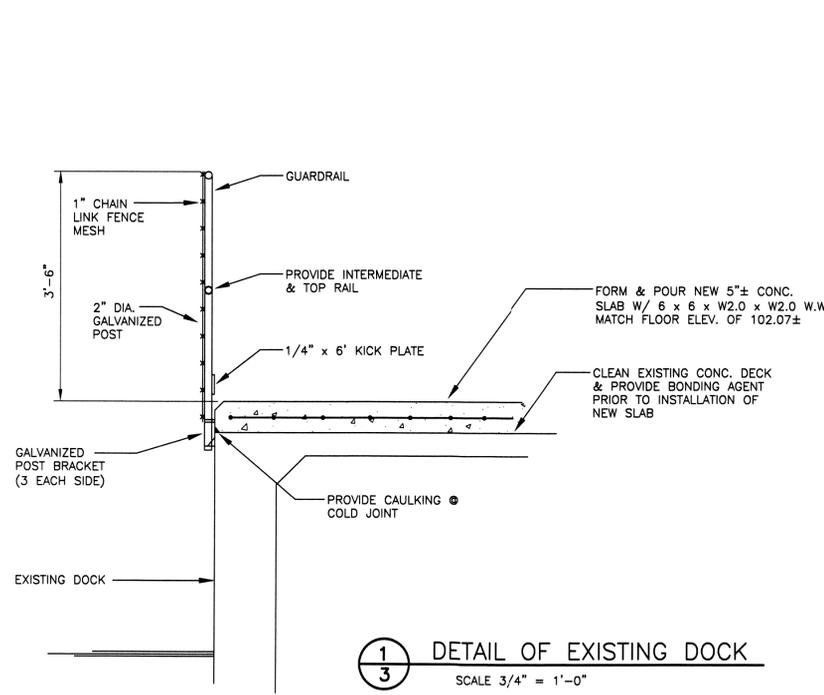

PROPOSED IMPROVEMENTS
AIRGAS EAST
2020 FALL RIVER AVENUE
A.P. 1 LOT 192
SEEKONK, MASSACHUSETTS

CAPUTO AND WICK LTD. DATE
1150 PAWTUCKET AVE. JUNE 2006
RUMFORD, R.I. 02916 SHEET
401-434-8880 3 OF 3