

NOTES:

- 1) ALL WORK SHALL CONFORM TO THE 310 CMR 15.00 STATE ENVIRONMENTAL CODE - TITLE 5 AND THE RULES AND REGULATIONS OF THE SEEKONK BOARD OF HEALTH.
- 2) STRIP ALL TOPSOIL, SUBSOIL AND UNSUITABLE MATERIAL (AT LEAST 3" INTO THE Gd2 HORIZON, TREE ROOTS AND STUMPS AND ANY OTHER IMPERVIOUS OR SPECIFIED SOIL IN THE AREA OF THE SYSTEM AND 5 FEET BEYOND IN ALL DIRECTIONS, WHERE POSSIBLE. REPLACE WITH GRANULAR FILL MEETING THE LATEST SPECIFICATIONS OF 310CMR15.255(3).
- 3) ALL PIPE TO BE 4" P. V. C. SCHEDULE 40 UNLESS OTHERWISE NOTED.
- 4) PLACE 6" MINIMUM COMPACTED CRUSHED STONE UNDER SEPTIC TANK AND DISTRIBUTION BOX.
- 5) IF CONDITIONS ENCOUNTERED DURING CONSTRUCTION VARY SUBSTANTIALLY FROM THOSE SHOWN ON THIS PLAN, NOTIFY CAPUTO AND WICK, LTD. BEFORE PROCEEDING WITH CONSTRUCTION.
- 6) GARBAGE GRINDER IS NOT ALLOWED WITH THIS DESIGN.
- 7) IT IS RECOMMENDED THAT THE SEPTIC TANK BE INSPECTED TWICE A YEAR, AND BE CLEANED WHEN THE SOLIDS EQUAL ONE THIRD THE LIQUID DEPTH.
- 8) BREAKOUT ELEVATION = 25.65. NO FINISHED GRADE BELOW 25.65 FOR 15 FEET (MINIMUM) FROM THE EDGE OF THE LEACHING AREA.
- 9) CONTRACTOR SHALL CONTACT "DIG-SAFE" PRIOR TO CONSTRUCTION. LOCATION OF UTILITIES ON THIS PLAN ARE FROM EXISTING INFORMATION, BUT ARE ONLY TO BE CONSIDERED APPROXIMATE.
- 10) THE CELLAR FLOOR ELEVATION SHOWN HAS BEEN SUGGESTED AS A MINIMUM BASED ON OBSERVED GROUNDWATER CONDITIONS. SINCE THE GROUNDWATER LEVELS FLUCTUATE ANNUALLY, NO WARRANTY OF A DRY CELLAR IS EXPRESSED OR IMPLIED.
- 11) ALL STONE USED FOR CONSTRUCTION OF THE SOIL ABSORPTION SYSTEM MUST BE DOUBLE WASHED AS SPECIFIED BY 310 CMR 15.241. ACTUAL STONE MATERIAL MAY ALSO BE SUBJECT TO APPROVAL BY THE DESIGN ENGINEER AND/OR SEEKONK HEALTH AGENT.

DESIGN DATA

DAILY SEWAGE FLOW
 PROPOSED BEDROOMS = FOUR
 DAILY FLOW = 110 GAL./DAY/BEDROOM x 4 BEDROOMS = 440 GALLONS PER DAY

SEPTIC TANK REQUIREMENTS
 VOLUME = 2 x DAILY FLOW = 880 GALLONS - MINIMUM SIZE = 1500 GALLONS

LEACHING AREA REQUIREMENTS
 PERCOLATION RATE = 5 MINUTES PER INCH - DESIGN FOR 5 MINUTES PER INCH - SOIL TEXTURE CLASS - I
 EFFLUENT LOADING RATE = 0.14 GAL. PER S. F.
 SIDEWALL AREA = N/A
 BOTTOM AREA = 24' x 30' = 720 SQUARE FEET
 TOTAL LEACHING AREA = 720 SQUARE FEET
 TOTAL LEACHING CAPACITY = 720 S. F. x 0.14 GAL./DAY/S. F. = 533 GAL./DAY > 440 GPD

DEEP OBSERVATION HOLE #1


DEPTH	SOIL TYPE
0	A S/L LOYR 3/1
10"	B L/S LOYR 5/8
30"	C1 MED. SAND 2.5 Y 1/4
64"	C2 CRS/SAND 2.5Y 5/4
100"	C3 MED. SAND 2.5 Y
132"	

PERC. DEPTH: 66"
 PERC. RATE: 2 MINUTES PER INCH
 DATE: 4/16/99
 WATER DEPTH: DRY @ 132"
 DATE: 4/16/99
 EST. HIGH GW: 132" (ELEV.=11.0)
 WITNESSES: MR. CHENEVERT, RICHARD C. BELLAVANCE
 PERFORMED BY: RICHARD C. BELLAVANCE

DEEP OBSERVATION HOLE #2

DEPTH	SOIL TYPE
0	A S/L LOYR 3/3
12"	B L/S LOYR 5/8
26"	C1 FINE MED. SAND 2.5 Y 6/3
64"	C2 MED. SAND 2.5Y 6/2
136"	

PERC. DEPTH: 46"
 PERC. RATE: 2 MINUTES PER INCH
 DATE: 4/16/99
 WATER DEPTH: DRY @ 136"
 DATE: 4/16/99
 EST. HIGH GW: 136" (ELEV.=16.3)
 WITNESSES: MR. CHENEVERT, RICHARD C. BELLAVANCE
 PERFORMED BY: RICHARD C. BELLAVANCE

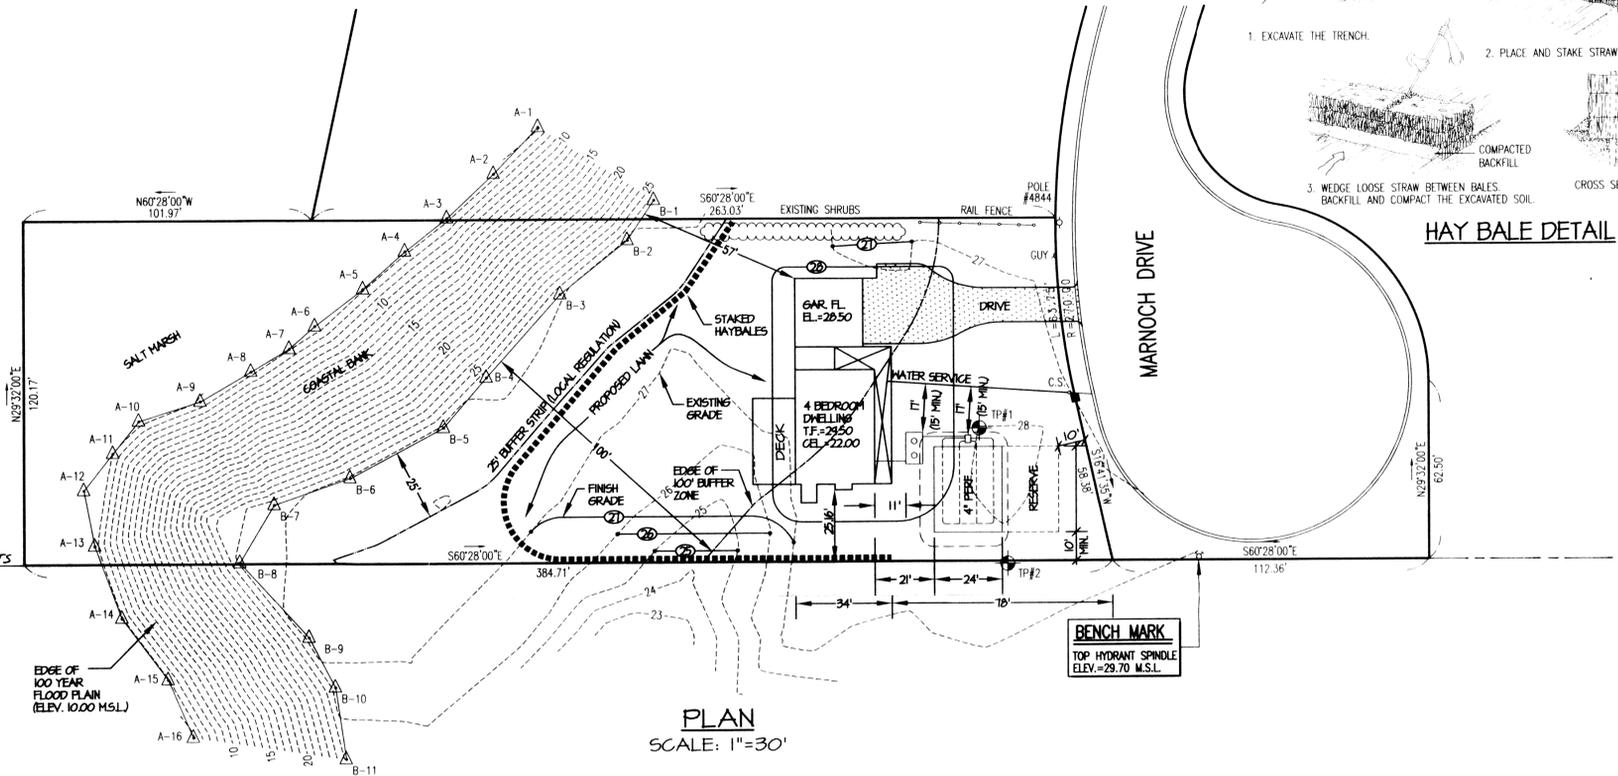

TOWN OF SEEKONK
 COMMONWEALTH OF MASSACHUSETTS
 CITY OF EAST PROVIDENCE,
 STATE OF RHODE ISLAND

I CERTIFY THAT I HAVE CONTACTED THE SEEKONK WATER DISTRICT FOR THE LOCATION OF THE EXISTING WATER SERVICE CURB STOP FOR PLAT 2, LOT 42

LEGEND

- 100- EXISTING CONTOUR
- 100L- PROPOSED CONTOUR
- MA STD. MASSACHUSETTS STANDARD
- INV. INVERT OF PIPE
- P. V. C. POLYVINYL CHLORIDE PIPE
- S. D. R. STANDARD DIMENSION RATIO
- R. C. P. REINFORCED CONCRETE PIPE
- CONC. CONCRETE (BIT. OR P. C.)
- BIT. BITUMINOUS
- P. C. PORTLAND CEMENT
- TYP. TYPICAL
- F.G. 100x00 FINISHED SPOT GRADE
- 100x00 EXISTING SPOT GRADE
- T. C. TOP OF CURB
- B. G. BOTTOM OF CURB
- P. PROPERTY LINE
- x-CLF-x- CHAIN LINK FENCE
- ST. SEPTIC TANK
- P.B. DISTRIBUTION BOX
- DEEP OBSERVATION HOLE
- EXISTING EDGE OF WOODS

EROSION AND SEDIMENTATION CONTROL

- 1) ALL PERIMETER EROSION AND SEDIMENTATION CONTROLS MUST BE INSTALLED PRIOR TO THE COMMENCEMENT OF EARTHWORK.
- 2) ACCESSIBLE RESERVES OF HAY BALES AND STAKES ARE TO BE MAINTAINED ON SITE FOR ROUTINE MAINTENANCE AND IN THE EVENT OF UNANTICIPATED PROBLEMS REQUIRING EMERGENCY RESPONSE.
- 3) HAY BALES SHOULD BE INSTALLED IN ACCORDANCE WITH THE DETAILS PROVIDED.
- 4) NO WORK IS TO OCCUR ON THE WETLAND SIDE OF THE PERIMETER EROSION AND SEDIMENTATION CONTROLS. ALL PERIMETER CONTROLS SERVE AS THE PROJECT LIMIT OF DISTURBANCE.
- 5) NO STONES, BRUSH, CONSTRUCTION DEBRIS, LITTER, OR OTHER MATERIALS ARE TO BE DEPOSITED ON THE WETLAND SIDE OF THE EROSION AND SEDIMENTATION CONTROLS.
- 6) ALL DISTURBED SOILS NOT DESIGNATED FOR OTHER SURFACE TREATMENT ARE TO BE LOAMED AND SEEDED IMMEDIATELY FOLLOWING FINAL GRADING.
- 7) APPROPRIATE PRECAUTIONS SHOULD BE TAKEN TO PREVENT THE TRANSPORT OF SOIL OFF SITE FROM CONSTRUCTION EQUIPMENT.
- 8) ALL PERIMETER EROSION AND SEDIMENTATION CONTROLS MUST BE PROPERLY MAINTAINED AND MUST REMAIN IN PLACE UNTIL THE SOILS HAVE BEEN STABILIZED TO THE SATISFACTION OF THE ENGINEER AND THE SEEKONK CONSERVATION COMMISSION.

ZONING INFORMATION


ASSESSOR'S PLAT 2
 LOT 42
 RECORD LOT 40
 ZONE: R1

69-461

Received


FEB 20 2001

Con. Comm.

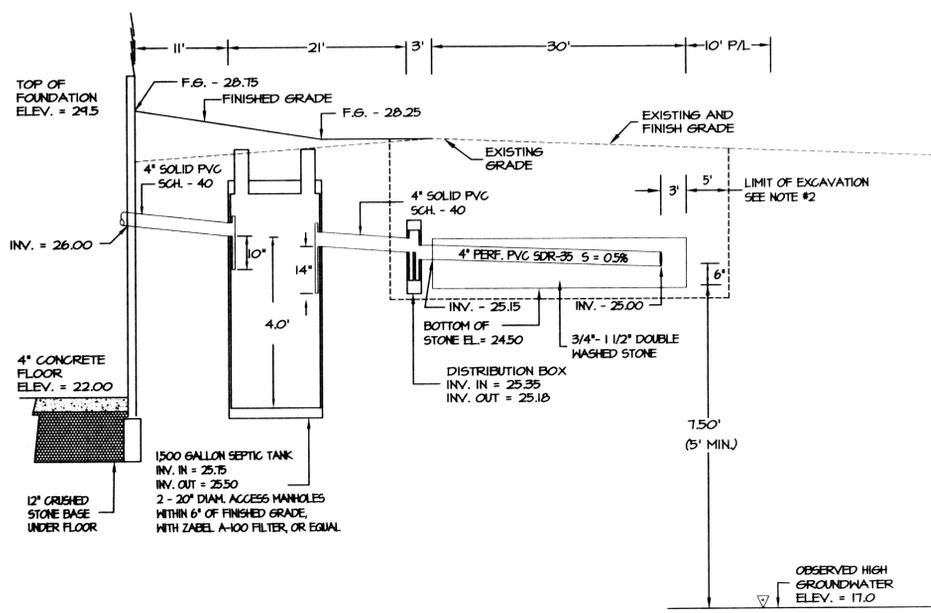

LEACHING TRENCH PROFILE

SCALE: HORIZONTAL: 1"=10'
 VERTICAL: 1"=2'

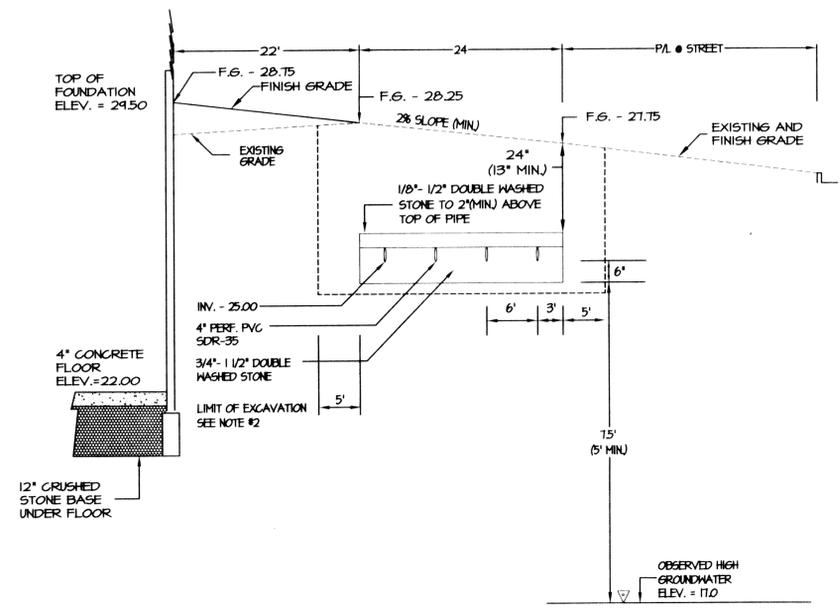

LEACHING TRENCH SECTION

SCALE: HORIZONTAL 1"=10'
 VERTICAL 1"=2'

SEWAGE DISPOSAL SYSTEM
 CHRIS AND KRYSYNNNE CLEGG
 MARNOCH DRIVE
 SEEKONK, MASSACHUSETTS

CAPUTO AND WICK LTD. DATE: 2/16/01
 1150 PAWTUCKET AVE. RUMFORD, R.I. 02916 SHEET 1 OF 1
 401-434-8880