


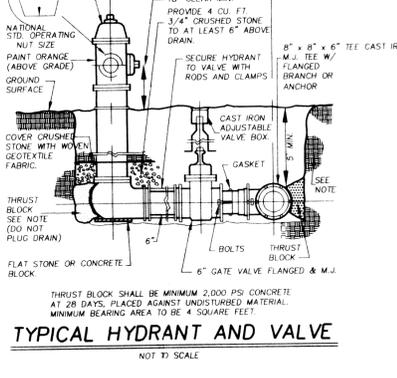
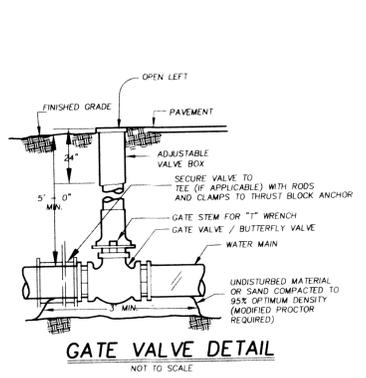
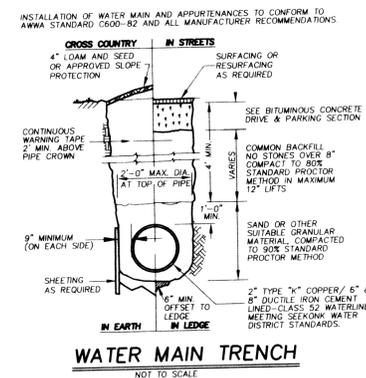
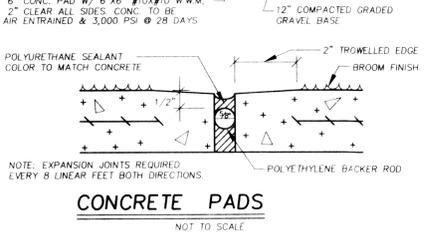
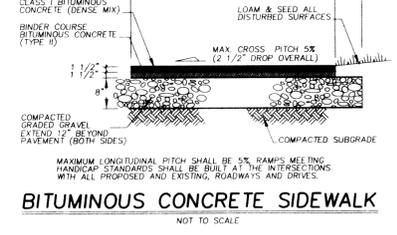
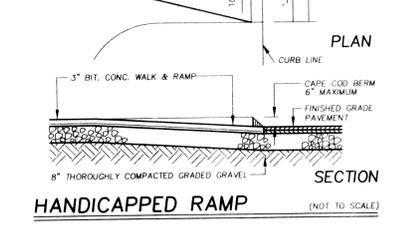
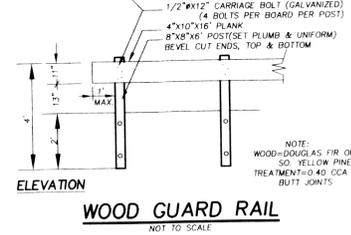



161 harvard avenue
allston, massachusetts




Civil Engineer, Landscape Architect,
Land Surveyor & Environmental Consultant
DAVID E. ROSS ASSOCIATES, INC.
111 Fitchburg Road
P.O. Box 368
Ayer, MA 01432
(508) 772-6232 FAX (508) 772-6258

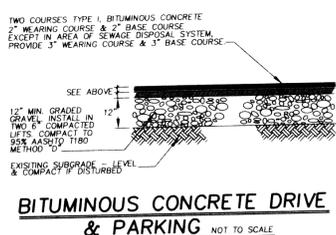













PIPE SIZE (M.)	1/4 BEND	1/8 BEND	1/16 BEND	PLUG & TEES
4.8	6.0	2.9	2.3	4.5
10	9.6	5.2	2.3	6.7
12	13.3	6.7	3.7	9.6
16	24.0	11.8	3.7	17.0

AREA OF BEARING FACE OF CONCRETE THRUST BLOCKS IN SQUARE FEET BASED ON 250 P.S.I. & 1.5 TONS/S.F. ALLOWABLE SOIL BEARING CAPACITY.

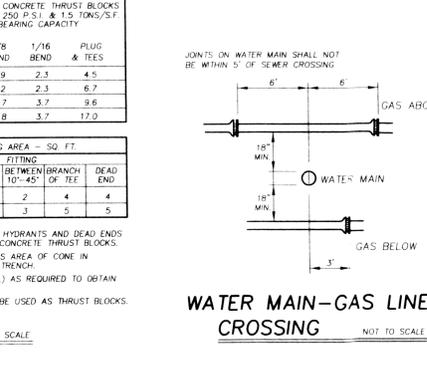

WATER SYSTEM NOTE: ALL CONNECTIONS/ CONSTRUCTION SHALL CONFORM TO THE REQUIREMENTS OF THE SEEKONK WATER DISTRICT.

DRAINAGE SYSTEM NOTE: ALL DRAINAGE CONNECTION/ CONSTRUCTION SHALL CONFORM TO THE REQUIREMENTS OF THE SEEKONK DEPT. OF PUBLIC WORKS.

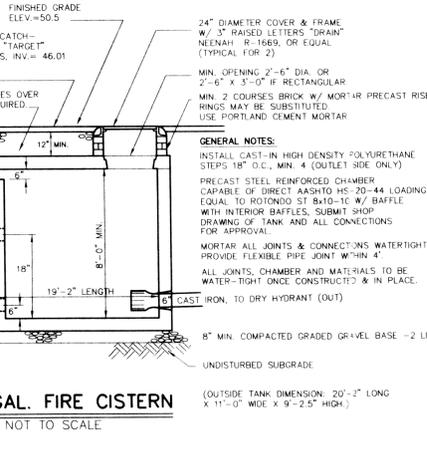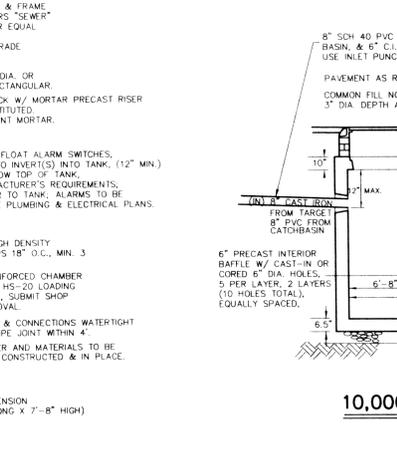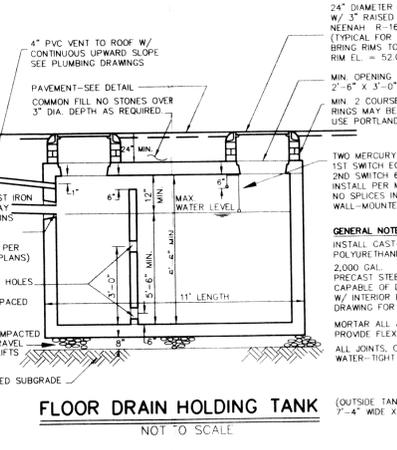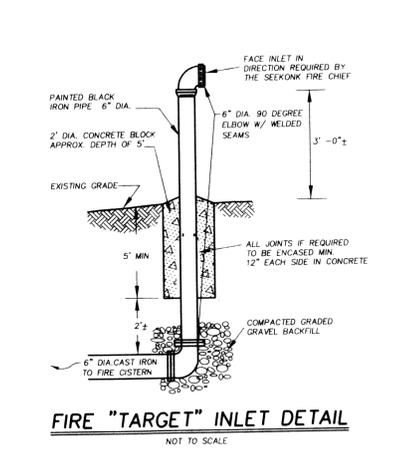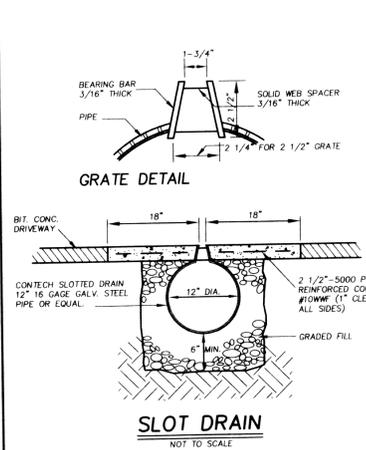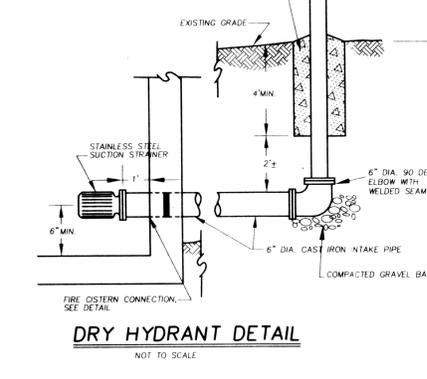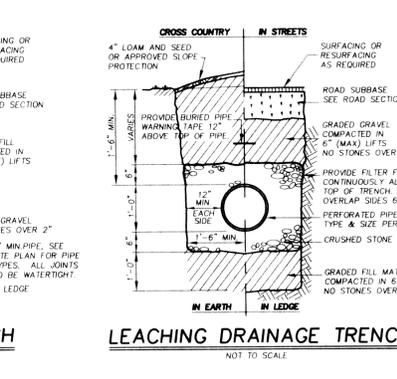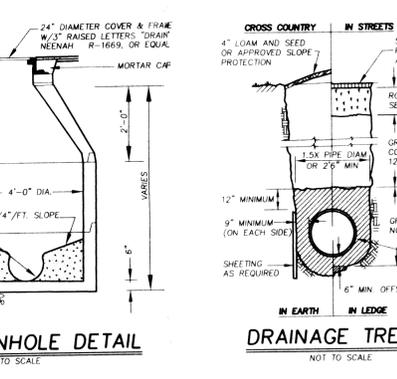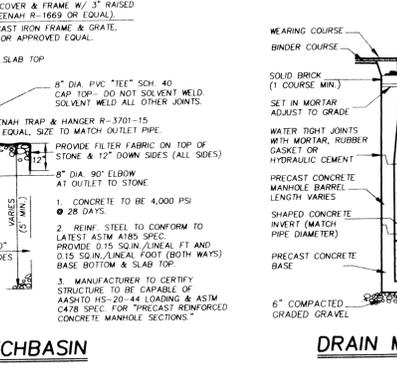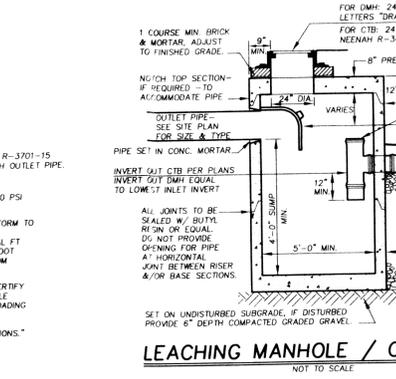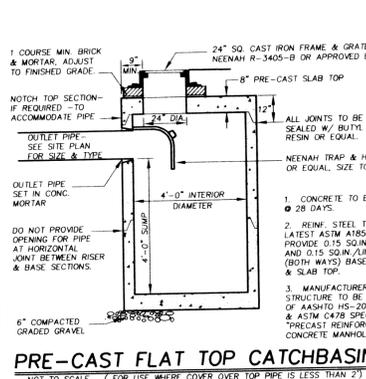

REVISIONS
5/5/97 GENERAL REVISION

SEEKONK FIRE AND POLICE STATION

SEEKONK, MASSACHUSETTS

CONSTRUCTION DETAILS

scale	AS NOTED
date	SEPTEMBER, 1996
drawn by	MLC/WEM
job no	602
sheet	4 of 6

C-5