


GENERAL NOTES

- THIS SEWAGE DISPOSAL SYSTEM SHALL BE CONSTRUCTED IN CONFORMANCE WITH THE REGULATIONS OF TITLE 5 OF THE STATE ENVIRONMENTAL CODE AND THE REGULATIONS OF THE LOCAL BOARD OF HEALTH.
- THE LOCAL BOARD OF HEALTH AND THE FIRE AFD TO BE NOTIFIED:
 - PRIOR TO BEGINNING CONSTRUCTION IN THE EXCAVATION FOR THE PURPOSE OF SOIL EXAMINATION TO INSURE CONTINUITY OF PERMEABLE MATERIAL.
 - PRIOR TO BACKFILLING THE COMPLETED SYSTEM FOR THE PURPOSE OF PERFORMING A GAS-BUILD INSPECTION IN A MANNER OTHER THAN SHOWN ON THIS DESIGN.
- CONTRACTOR TO VERIFY ALL UTILITY LOCATIONS PRIOR TO CONSTRUCTION THROUGH DIG SAFE AND OTHER APPROPRIATE AGENCIES. REPORT ANY DISCREPANCIES TO THE DESIGN ENGINEER.
- ALL SEPTIC SYSTEM COMPONENTS SHALL WITHSTAND H-10 LOADING UNLESS LOCATED WITHIN H-20 LOADING.
- WHERE REQUIRED CONTRACTOR WILL REMOVE ALL LOAM, SUBSOIL AND OTHER UNSUITABLE MATERIAL IN THE AREA BENEATH AND FOR 5 FEET ON ALL SIDES OF THE LEACHING FACILITY. THE CONTRACTOR SHALL PLACE AND FINISH OR OTHER UNSUITABLE MATERIAL. REPLACEMENT MATERIAL TO HAVE AN INFILTRATE PERCENTAGE OF TWO MINUTES OR LESS.
- 4\"/>

THIS SYSTEM IS NOT DESIGNED FOR USE WITH A GARBAGE DISPOSAL

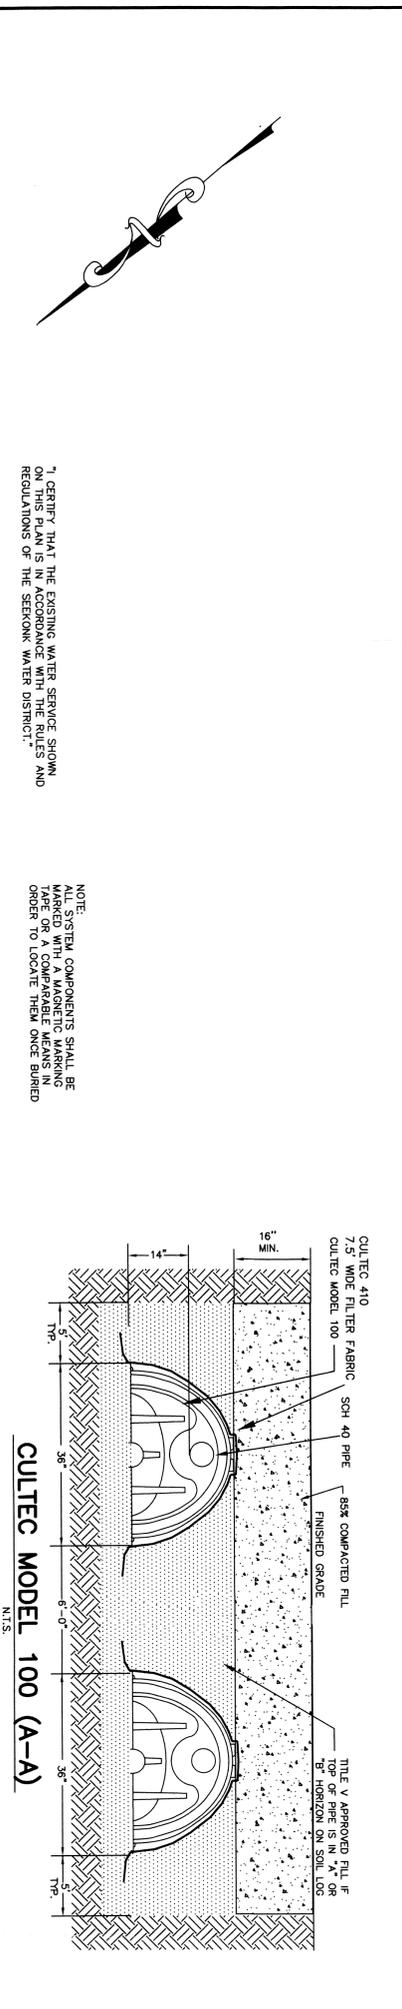


TEST PIT DATA

WITNESS: BETH HALLAM
PERFORMED BY: JAMES HALL
DATE: 3/29/12

TEST PIT #	1	2
EL. TOP	101.5	101.0
EL. WATER	91.5	91.0
PERC. RATE	< 2 M.P.I.	< 2 M.P.I.

DEPTH	1	2
0\"/>		

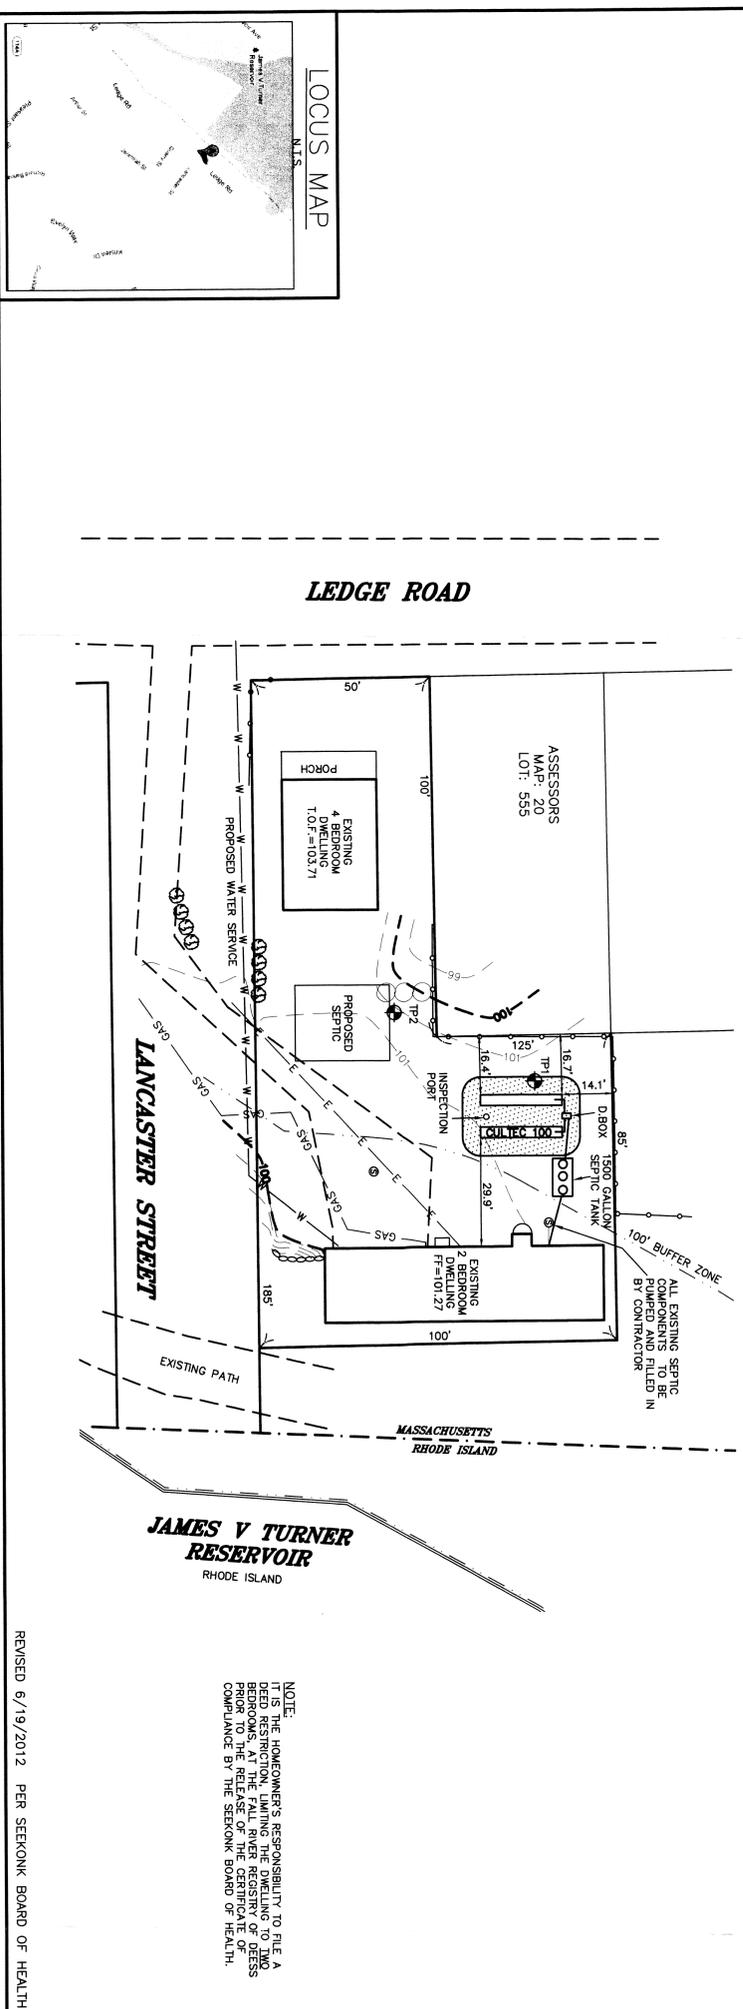

DESIGN DATA

CAPACITY REQUIRED
2 BEDROOMS AT 110 GAL./DAY/BDRM. = 220 GAL./DAY

SEPTIC TANK
220 GALS. X 200% = 440 GALS. DESIGN CAPACITY
USE 1,500 GALLON SEPTIC TANK

CAPACITY PROVIDED
PER D.E.P. PERMIT OF GRATELESS SYSTEM:
BOTTOM AREA > 6.7 SF/2\"/>

REVISIONS: 6/19/2012 PER SEEKONK BOARD OF HEALTH

1788 G.A.R. HIGHWAY
Swarthout, MA 02777
(508) 379-1234

Mount Hope
ENGINEERING INC.
CIVIL/ENVIRONMENTAL SERVICES
P.O. BOX 943
Pawtucket, RI 02871
(401) 683-1834